


**GENERAL NOTES:**

These drawings are intended solely to act as an aid when designing a wall. This drawing should not be used for final design or construction.

Each site-specific wall should be certified and signed by a registered geotechnical engineer in the State or Province that it is being built.

The accuracy and use of the details in this document are the sole responsibility of the user.

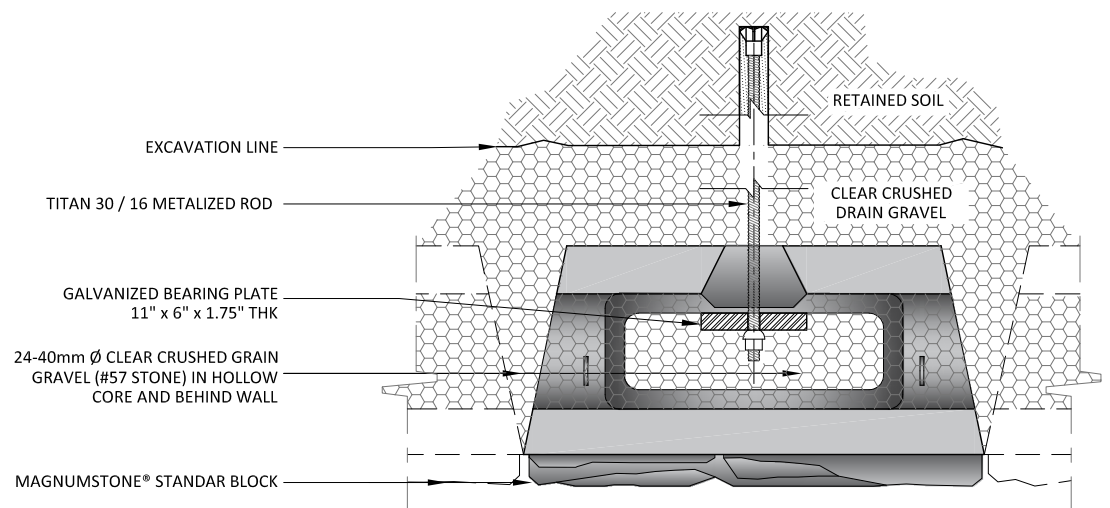


**PLAN**

OPTION 1 - SOIL NAIL WITH BEARING PLATE			
DESIGN LOAD (KIPS)	fc (28 DAYS) (PSI)	BEARING PLATE SIZE (inch)	BEARING PLATE THICKNESS (inch)
29.7	4,000	10 x 5.5	1.5
25.0	4,000	9.5 x 5.25	1.5
20.0	4,000	9.25 x 4.75	1.5
15.0	4,000	9.0 x 4.25	1.25
10.0	4,000	8.75 x 3.5	1.25
5.0	4,000	8.0 x 3.0	1.0

**GENERAL NOTES:**

- TITAN 30/16 ROD TO BE METALIZED
  - BEARING PLATE GRADE, 50 KSI, GALVANIZED AFTER FABRICATION
- VERTICAL/HORIZONTAL NAILS SPACING BASED ON REQUIRED CAPACITY.

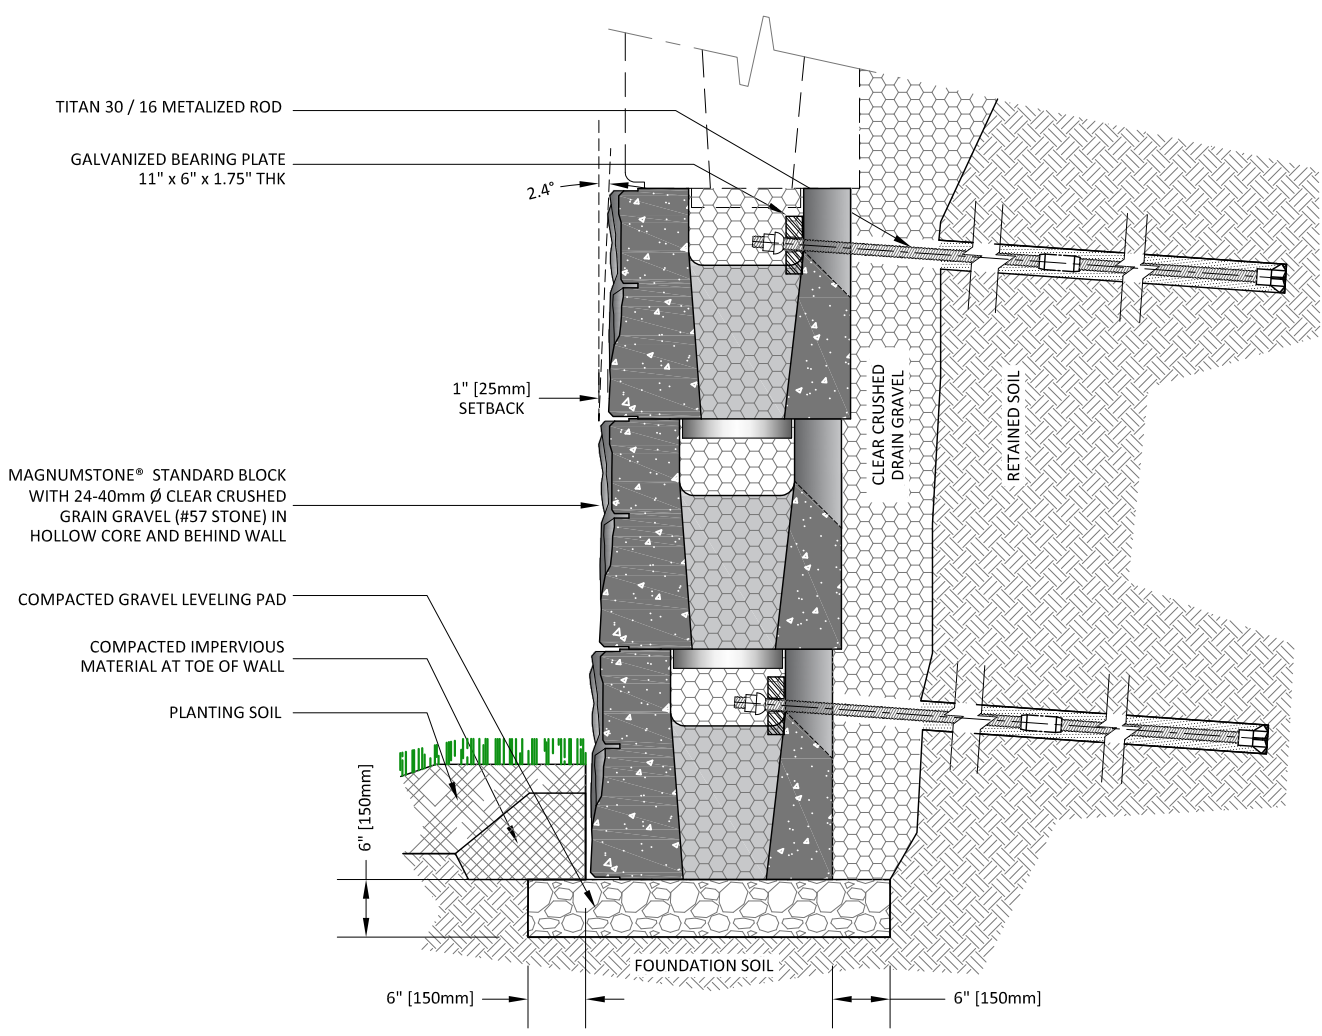

**CROSS SECTION**

**01 SOIL NAIL WITH BEARING PLATE**  
OPTION 1 SCALE 1:20

Rev	DESCRIPTION	DATE
01	ADDENDUM INFORMATION	08-10-2023
00	INTERNAL APPROVAL	07-01-2023

**REMARKS:**

**PURPOSE OF ISSUE:**

- INFORMATION
- REVIEW / APPROVAL
- PRODUCTION

**SHEET CONTENT**

**MAGNUMSTONE® SOIL ANCHOR WALL**

**OPTION - 1**

**SOIL NAIL WITH BEARING PLATE**

**SHEET REFERENCE**


**101**

**1104-MS-ETC**


**DRAWING INFORMATION**

SCALE: 1 : 20  
PAPER SIZE: 17" WD X 11" HT  
PREPARED BY: RM



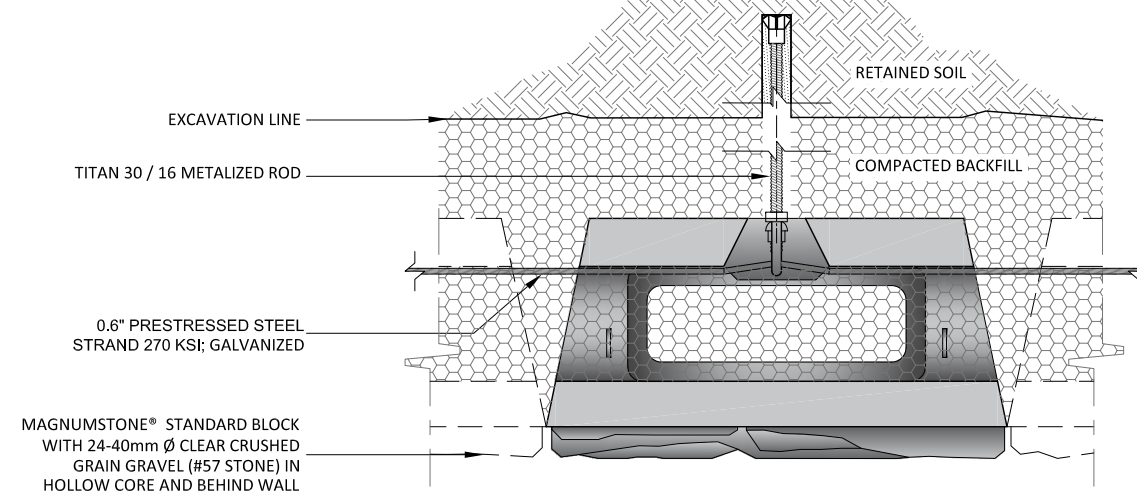

**PLAN**

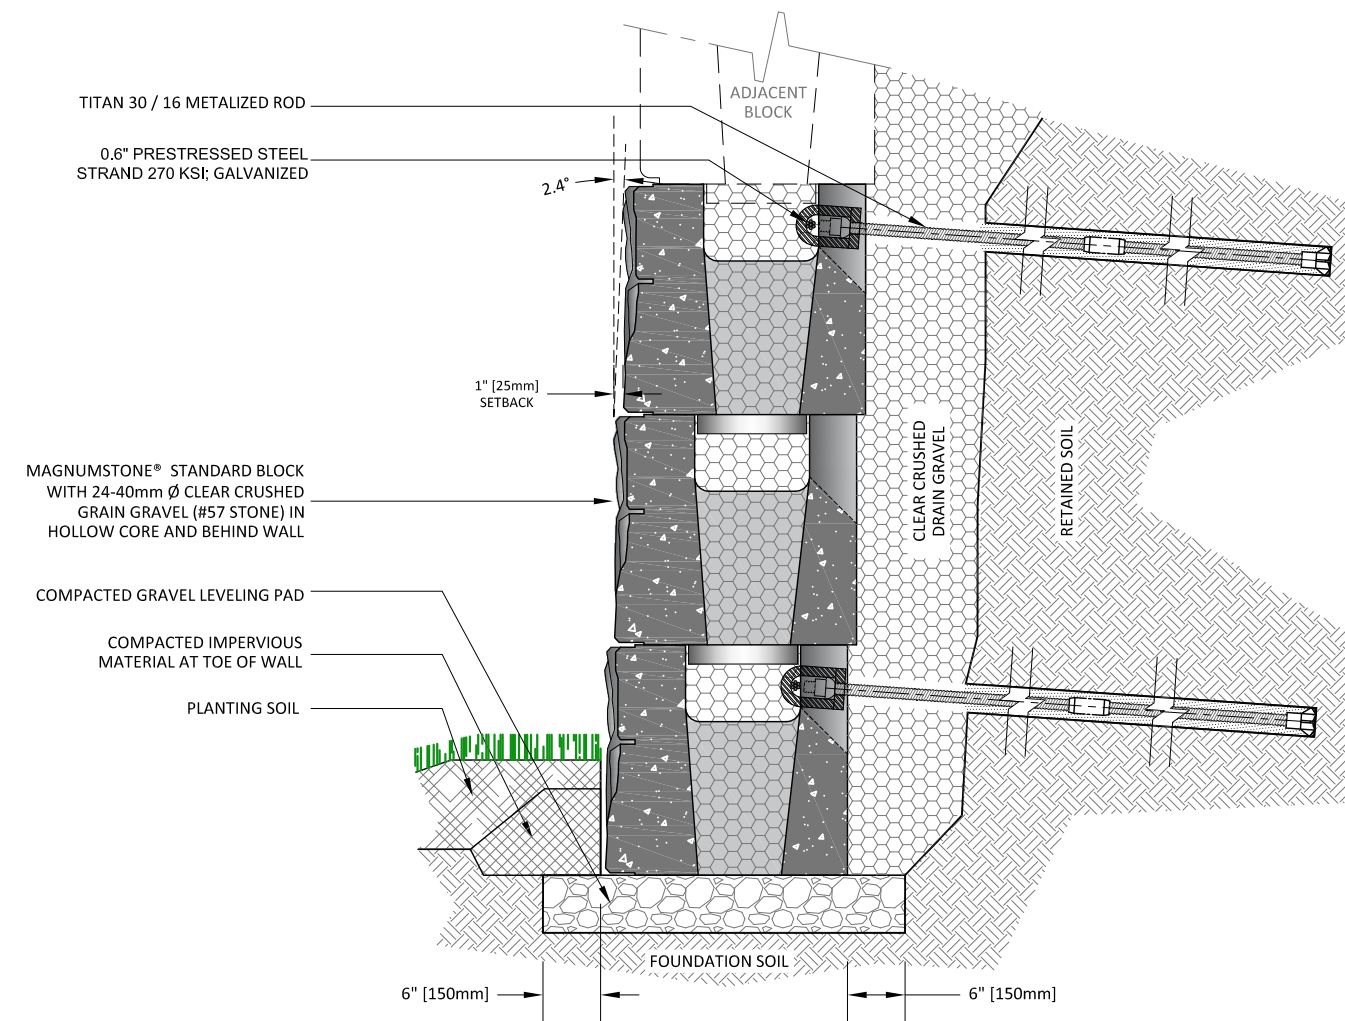

**CROSS SECTION**

**02** SOIL NAIL WITH 0.6" PRESTRESSED STEEL STRAND  
OPTION 2 SCALE 1:20

**GENERAL NOTES:**

1. TITAN 30/16 ROD TO BE METALIZED
2. 0.6" PRESTRESSED STEEL STRAND, 270 KSI, TO BE GALVANIZED.
3. EYE TO BE METALIZED
4. VERTICAL/HORIZONTAL NAILS SPACING BASED ON REQUIRED CAPACITY.

**GENERAL NOTES:**

These drawings are intended solely to act as an aid when designing a wall. This drawing should not be used for final design or construction.

Each site-specific wall should be certified and signed by a registered geotechnical engineer in the State or Province that it is being built.

The accuracy and use of the details in this document are the sole responsibility of the user.

Rev	DESCRIPTION	DATE
01	ADDENDUM INFORMATION	08-10-2023
00	INTERNAL APPROVAL	07-01-2023

**REMARKS:**

**PURPOSE OF ISSUE:**

- INFORMATION
- REVIEW / APPROVAL
- PRODUCTION

**SHEET CONTENT**

**MAGNUMSTONE®  
SOIL ANCHOR WALL**

**OPTION - 2**

**SOIL NAIL WITH 0.6"  
PRESTRESSED STEEL  
STRAND**

**SHEET REFERENCE**

**102**

**1104-MS-ETC**

**DRAWING INFORMATION**

SCALE : 1 : 20  
PAPER SIZE: 17" WD X 11" HT  
PREPARED BY: RM




**GENERAL NOTES:**


These drawings are intended solely to act as an aid when designing a wall. This drawing should not be used for final design or construction.

Each site-specific wall should be certified and signed by a registered geotechnical engineer in the State or Province that it is being built.

The accuracy and use of the details in this document are the sole responsibility of the user.

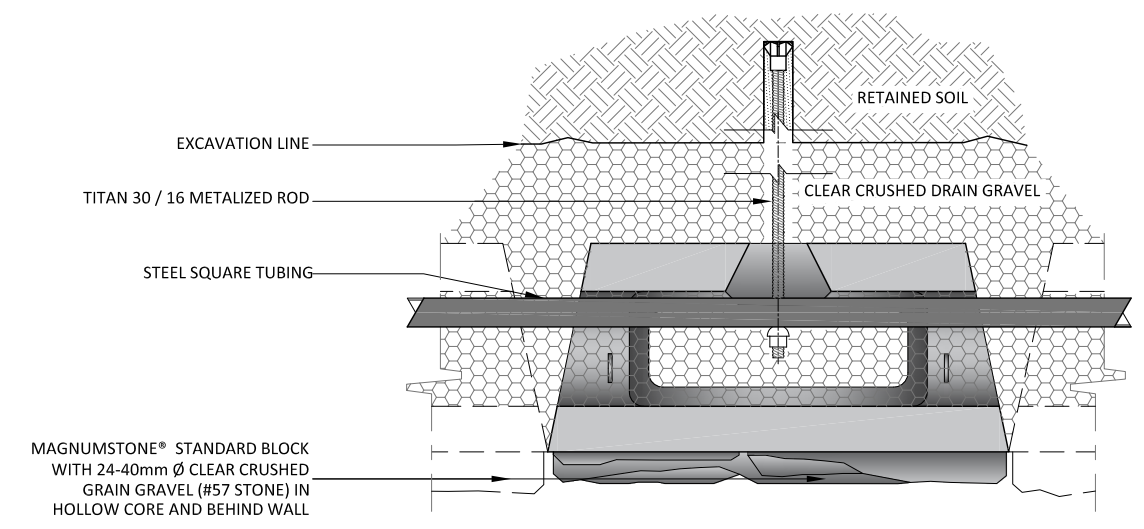

**PLAN**

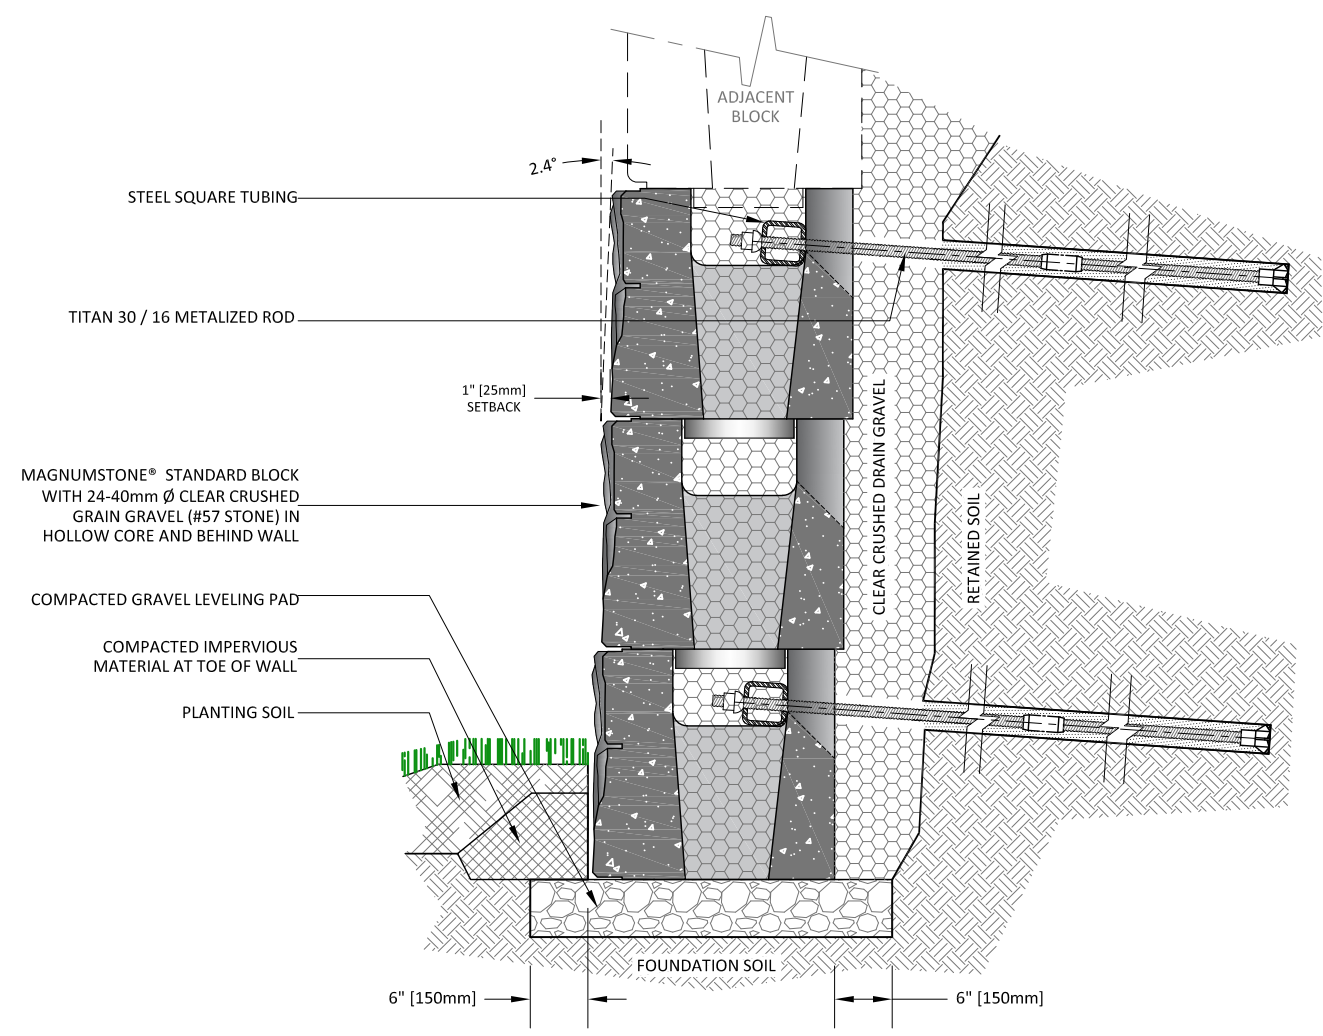

**CROSS SECTION**

**03** SOIL NAIL WITH STEEL TUBING  
OPTION 3 SCALE 1:20

OPTION 3 - SOIL NAIL WITH STEEL SQUARE TUBING				
DESIGN LOAD (KIPS)	fc (28 DAYS) (PSI)	min. SECTION MODULUS (inch <sup>3</sup> )	STEEL SQUARE TUBING SIZE (inch)	STEEL PIPE (inch)
29.7	4,000	1.258	3 x 3 x 0.25	3.5" SCH 40
25.0	4,000	1.058	2.75 x 2.75 x 0.25	3.5" SCH 40
20.0	4,000	0.847	2.63 x 2.63 x 0.25	3" SCH 40
15.0	4,000	0.635	2.38 x 2.38 x 0.20	3" SCH 40
10.0	4,000	0.423	2.25 x 2.25 x 0.188	2.5" SCH 40
5.0	4,000	0.212	2.0 X 2.0 X 0.188	2" SCH 40

GENERAL NOTES:

- TITAN 30/16 ROD HAVE TO BE METALIZED
- STRUCTURAL STEEL TUBING TO BE GALVANIZED
- VERTICAL/HORIZONTAL NAILS SPACING BASED ON REQUIRED CAPACITY.

Rev	DESCRIPTION	DATE
01	ADDENDUM INFORMATION	08-10-2023
00	INTERNAL APPROVAL	07-01-2023

REMARKS:

PURPOSE OF ISSUE:

- INFORMATION
- REVIEW / APPROVAL
- PRODUCTION

SHEET CONTENT

MAGNUMSTONE® SOIL ANCHOR WALL

OPTIONS - 3

SOIL NAIL WITH STEEL SQUARE TUBING

SHEET REFERENCE

**103**  
1104-MS-ETC

DRAWING INFORMATION

SCALE: 1:20  
PAPER SIZE: 17" WD X 11" HT  
PREPARED BY: RM



BAR SIZE	AREA (in <sup>2</sup> )	GUTS(kips)	YIELD(kips)	Max.TEST (kips)	Max.DESIGN LOAD (kips)	BAR LENGTH (ft)
TITAN 30/16	0.59	49.5	40.5	39.6	29.7	10

AVERAGE ULTIMATE BOND STRESS - ROCK/GROUT	psi	CARBIDE DRILL BIT SIZE (in)	FACTOR OF SAFETY	min. BOND LENGTH (ft)
GRANITE & BASALT	250 - 450	2	1.5	2.4
DOLOMOTIC LIMESTONE	200 - 300	2	1.5	2.9
SOFT LIMESTONE	150 - 200	2	1.5	4.0
SLATES & HARD SHALES	120 - 200	2	1.5	4.9
SOFT SHALES	30 - 120	2	1.5	19.7
SAND STONES	120 - 250	2	1.5	4.9
WEATHERED SANDSTONES	100 - 120	2	1.5	5.9
CHALK	30 - 155	2	1.5	19.7
WEATHERED MARL	25 - 35	2	1.5	29.5
CONCRETE	200 - 400	2	1.5	2.9

AVERAGE ULTIMATE BOND STRESS - COHESIVE SOILS/GROUT	psi	CLAY DRILL BIT SIZE (in)	FACTOR OF SAFETY	min. BOND LENGTH (ft)
SOFT SILTY CLAY	5 - 10	3.75	1.5	45.2
SILTY CLAY	5 - 10	3.75	1.5	45.2
STIFF CLAY, MED. TO HIGH PLASTICITY	5 - 15	3.75	1.5	45.2
VERY STIFF CLAY, MED. TO HIGH PLASTICITY	10 - 25	3.75	1.5	22.6
STIFF CLAY, MED. PLASTICITY	15 - 35	3.75	1.5	15.1
VERY STIFF CLAY, MED. PLASTICITY	20 - 50	3.75	1.5	11.3
VERY STIFF SANDY SILT, MED. PLASTICITY	40 - 55	3.75	1.5	5.6

AVERAGE ULTIMATE BOND STRESS - COHESIONLESS SOILS /GROUT	psi	DRILL BIT SIZE (in)	FACTOR OF SAFETY	min. BOND LENGTH (ft)
FINE-MED. SAND, MED. DENSE - DENSE	12 - 55	3.5	1.5	18.5
MED.-COARSE SAND (W/GRAVEL), MED.-DENSE	16 - 95	3.5	1.5	13.9
MED.-COARSE SAND ( W/GRAVEL), DENSE-VERY DENSE	35 - 140	3.5	1.5	6.4
SILTY SAND	25 - 60	3.5	1.5	8.9
DENSE GLACIAL TILL	43 - 75	3.5	1.5	5.2
SANDY GRAVEL, MED. DENSE - DENSE	31 - 200	3.5	1.5	7.2
SANDY GRAVEL, DENSE - VERY DENSE	40 - 200	3.5	1.5	5.6

**GENERAL NOTES:**

These drawings are intended solely to act as an aid when designing a wall. This drawing should not be used for final design or construction.

Each site-specific wall should be certified and signed by a registered geotechnical engineer in the State or Province that it is being built.

The accuracy and use of the details in this document are the sole responsibility of the user.

NOTE:  
BOND LENGTH CALCULATED WITH MAX. DESIGN LOAD OF 29.7 kips PER ROD. IF MAGNUMSTONE® REQUIRE LOWER DESIGN LOAD, DIFFERENT IN LOAD (%) WILL APPLY ON THE BOND LENGTH TOO.

Rev	DESCRIPTION	DATE
01	ADDENDUM INFORMATION	08-10-2023
00	INTERNAL APPROVAL	07-01-2023

**REMARKS:**

**PURPOSE OF ISSUE:**

- INFORMATION
- REVIEW / APPROVAL
- PRODUCTION

**SHEET CONTENT**

**MAGNUMSTONE® SOIL ANCHOR WALL**

**BOND LENGTH FOR TITAN 30/16 APPLICATION**

**SHEET REFERENCE**

**301**

**1104-MS-ETC**

**DRAWING INFORMATION**

SCALE : 1 : 20  
PAPER SIZE: 17" WD X 11" HT  
PREPARED BY: RM



**MagnumStone®**  
RETAINING WALLS

www.MAGNUMSTONE.com | 1 (800) 939-8193